

Monthly Fire Report for March 2026

Incident Count


144


Fire Calls

43

EMS Calls

101


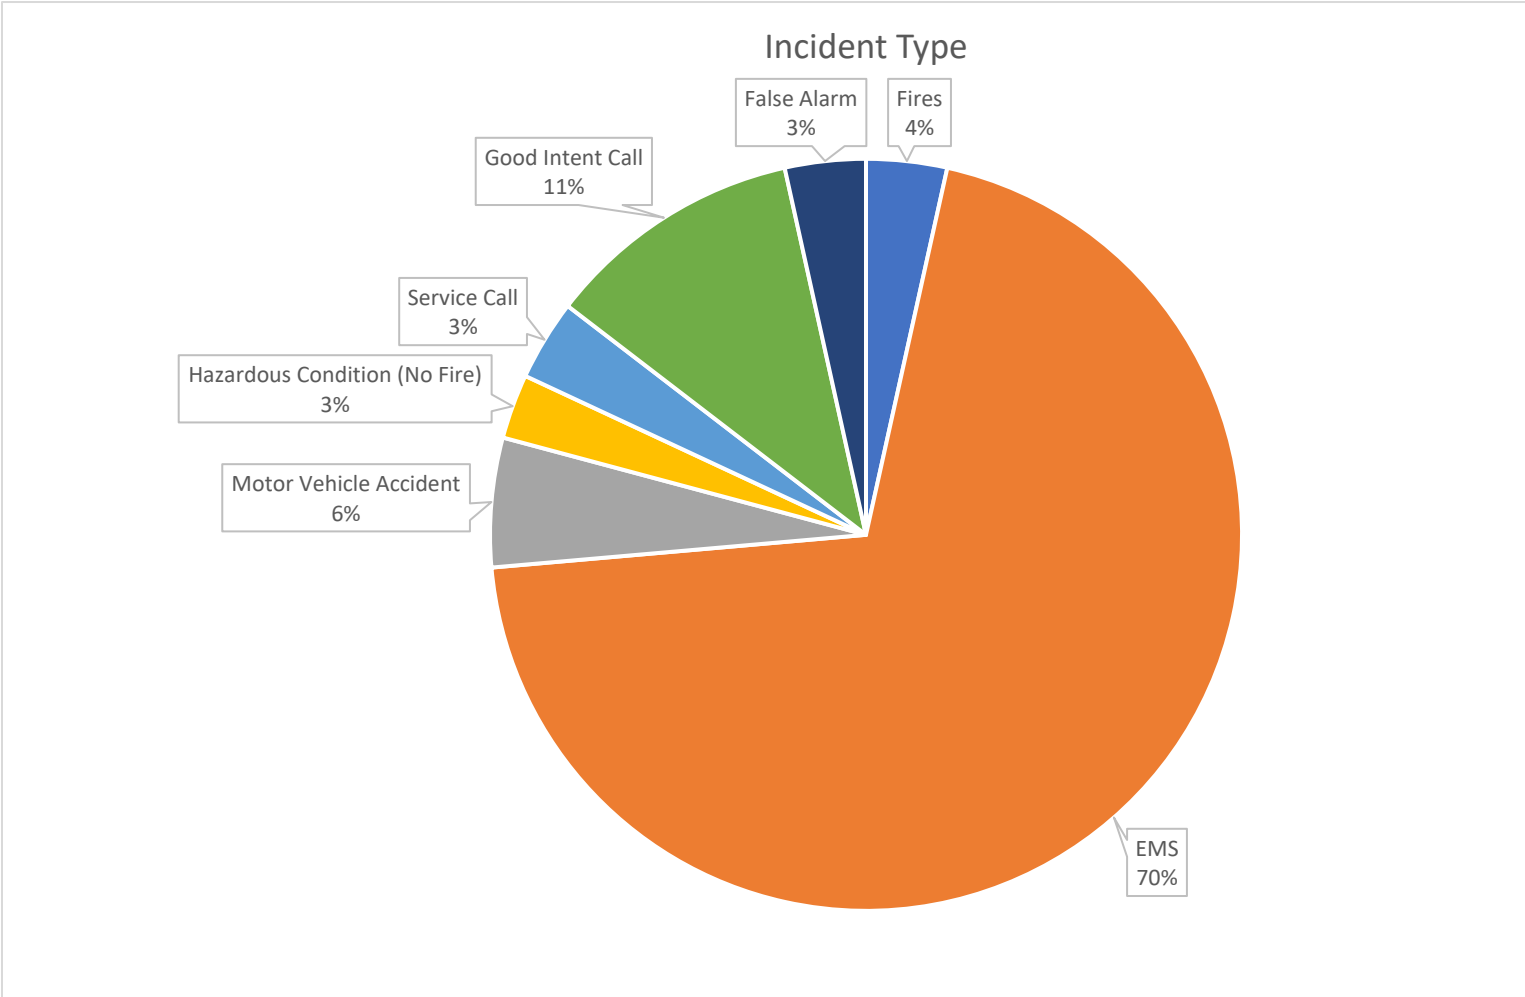


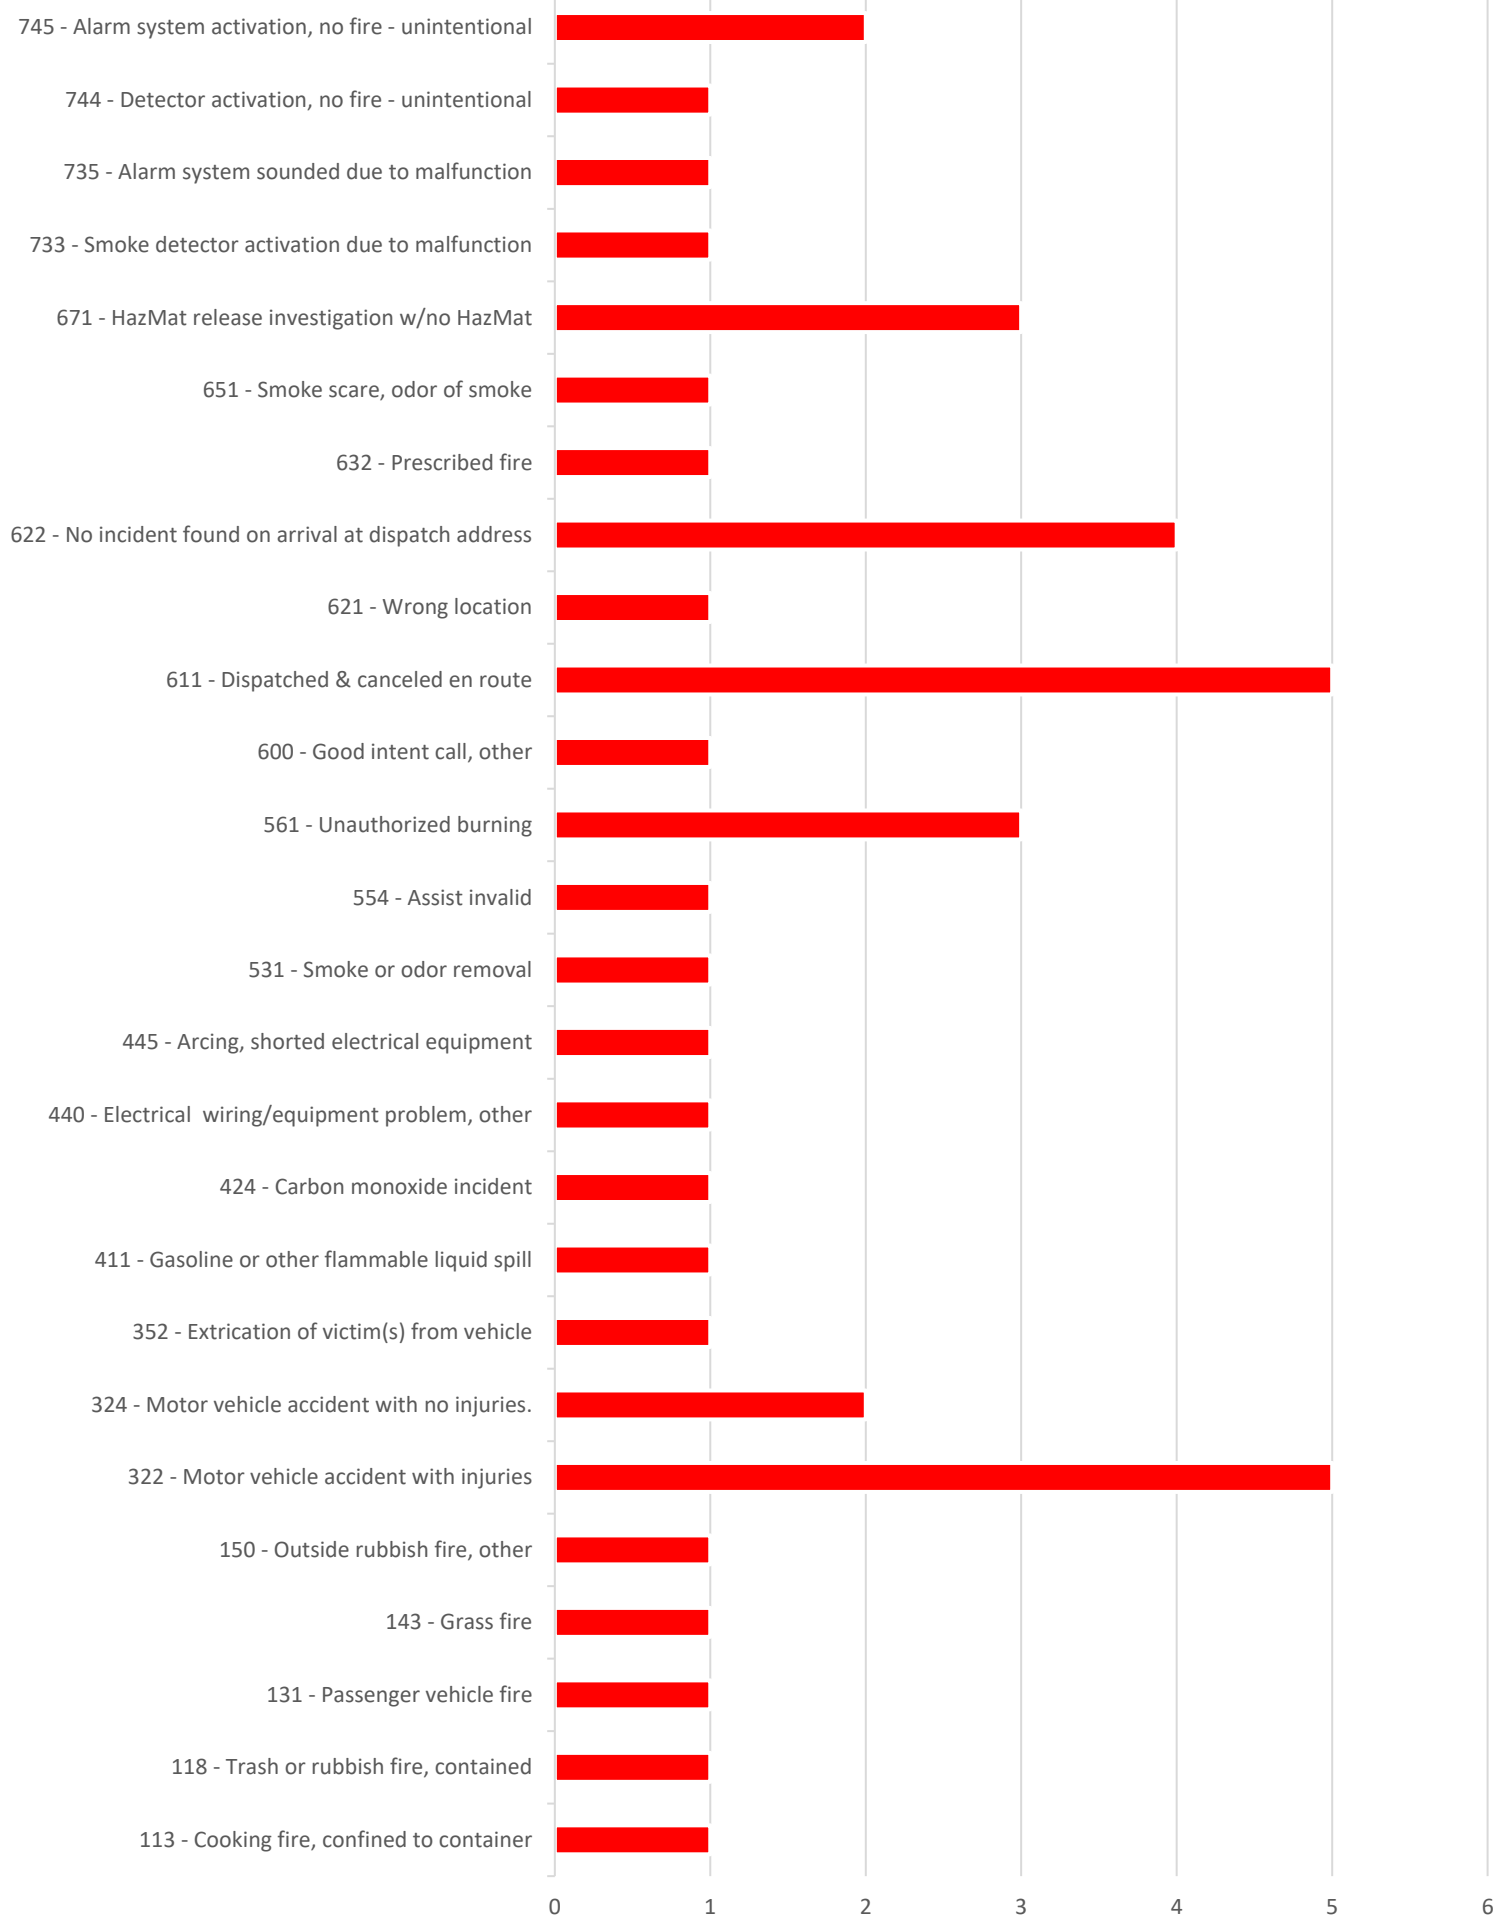

Aid Given or Received

Given 1

Received 0

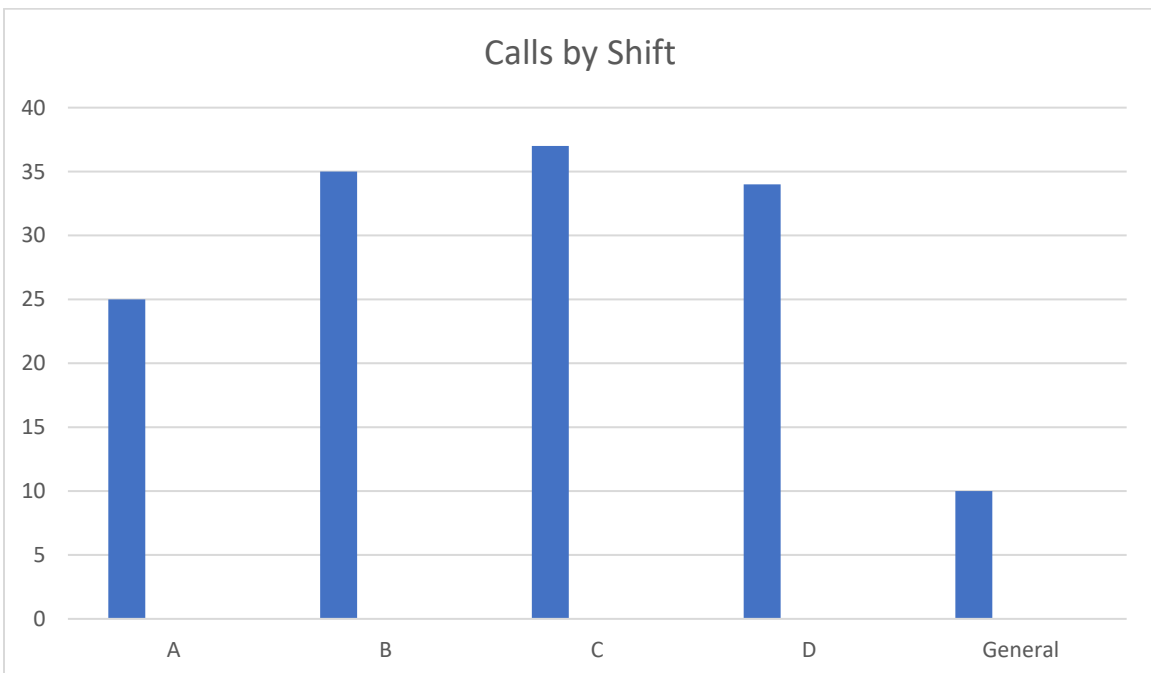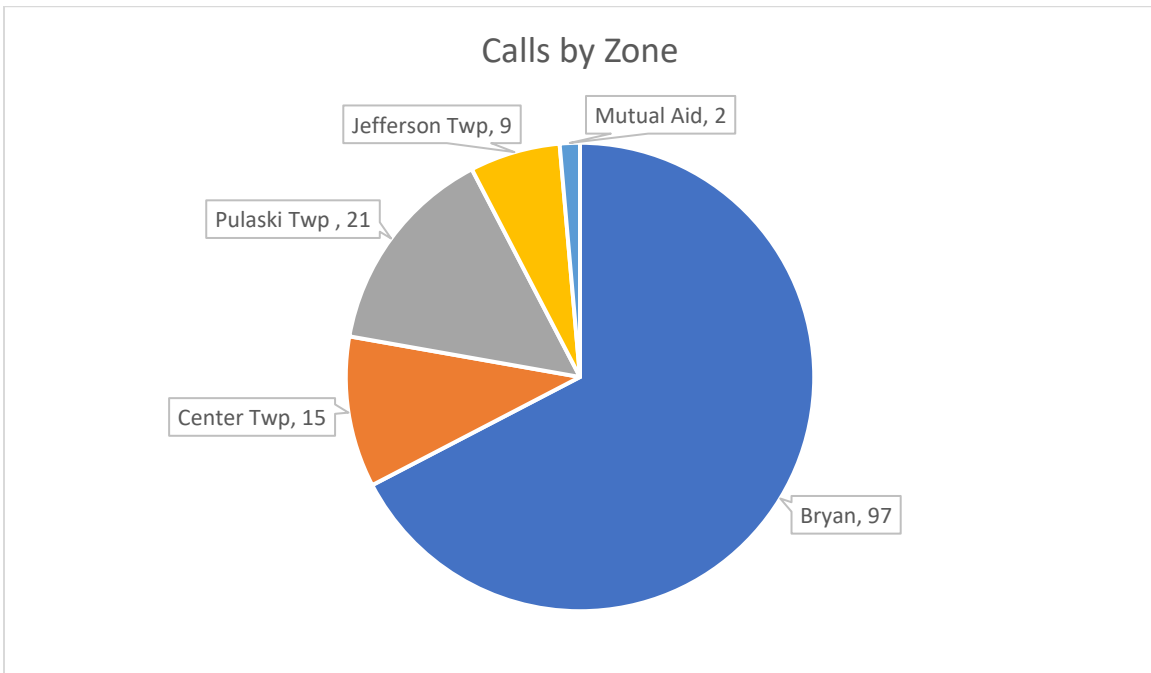




FDR-IR: Apparatus Call Time and Percent Utilization (Last Month)

APPARATUS	TOTAL CALL TIME	% OF TOTAL TIME
Chief 20	09:33:27	1.28%
Chief 21	07:29:00	1.01%
Engine 21	00:05:30	0.01%
Engine 24	10:22:53	1.40%
Medic 2	26:39:21	3.58%
POV	02:13:08	0.30%
Rescue 25	04:39:07	0.63%
Tahoe 2	18:18:22	2.46%
Tanker 26	00:28:00	0.06%
Truck 28	01:55:07	0.26%



FDR-INSP: Inspection Count by Type

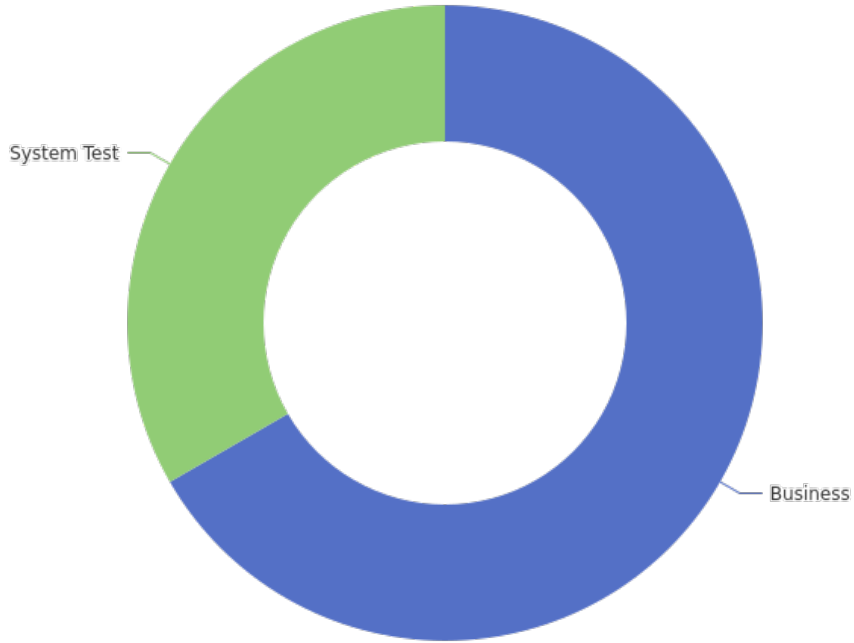

INSPECTION TYPE NAME	TOTAL
Business	2
System Test	1
Total	3



FDR-INSP: Inspection Violation Summary

CHECKLIST ITEM QUESTION	COUNT	PERCENT OF TOTAL
Activation of fire extinguishing system shall automatically shutdown fuel or electrical power supply	1	5.56%
Automatic fire-extinguishing systems shall be maintained in accordance with Title 19	1	5.56%
Automatic fire-extinguishing systems shall be serviced not less than every 6-months	1	5.56%
Emergency electrical system shall automatically illuminate means of egress in rooms or spaces requiring 2 or more exits	1	5.56%
Emergency lighting shall be maintained, inspected, and tested in accordance to the Code	1	5.56%
Emergency power system shall provide power for a duration of not less than 90-minutes	1	5.56%
Fire protection equipment shall be maintained in operative condition	1	5.56%
Fusible links and sprinkler heads shall be replaced annually	1	5.56%
Fusible links shall be maintained	1	5.56%
Hoods, grease-removal devices, fans, and ducts shall be cleaned at required intervals	1	5.56%
Illumination under emergency power shall be provided of not less than 1 footcandle (11 lux)	1	5.56%

FDR-INSP: Inspection Violation Summary

Bryan Fire Department (OH)
Address: 304 W High St, Bryan, OH, 43506



CHECKLIST ITEM QUESTION	COUNT	PERCENT OF TOTAL
In Room 6 there are 2 power strips that are daisy chained together. (One plugged into another) Power strips must be plugged directly into the wall without other power strips or extension cords plugged into them.	1	5.56%
Inspection tag for commercial kitchen hood and duct shall be provided in a conspicuous location	1	5.56%
Means of egress serving a room or space shall be illuminated at all times room or space is occupied	1	5.56%
NFPA approved automatic fire sprinkler system shall be provided	1	5.56%
Personnel providing maintenance to automatic fire-extinguishing system shall possess a valid certification	1	5.56%
Records of inspections, tests, and maintenance shall be maintained	1	5.56%
Water-based fire protection systems inspected, tested, and maintained per NFPA 25	1	5.56%
Total	18	100.00%